



**GOVERNMENT OF TELANGANA  
FIRE, DISASTER RESPONSE, EMERGENCY & CIVIL DEFENCE DEPARTMENT**



From  
The District fire officer,  
Medchal District.

To,  
LEAD INDIA BHARATRATNAS SCHOOL,  
LEAD INDIA BHARATRATNAS SCHOOL,  
sy.no.77,  
78,  
79.BANDLAGUDA (V),  
KEESARA (M),  
MEDCHAL (D),  
HYDERABAD,  
TELANGANA STATE,

Ack. No.652080002026 Dated:15/04/2026

Sir,  
Sub: Telangana Fire, Disaster Response, Emergency & Civil Defence Department —Medchal District. Renewal of No Objection Certificate for Occupancy to the Non Multi storeyed Building of **LEAD INDIA BHARATRATNAS SCHOOL.,LEAD INDIA BHARATRATNAS SCHOOL, sy.no.77, 78,79.BANDLAGUDA V, KEESARA M, MEDCHAL D, HYDERABAD, TELANGANA STATE/- Ahmedguda/Keesara/Medchal**, – Regarding.



Ref: 1. Acknowledgement No 652080002026  
2. This Office NOC for Occupancy Ack/RC No.1346 dt.15/04/2026  
3. Non Multi storeyed Building Inspection Committee Report,  
Ack. No. 652080002026, dt. 15/04/2026  
\*\*\*\*\*

1) The Non Multi storeyed Building Inspection committee, vide reference cited (3) has inspected the Non Multi storeyed Building of **LEAD INDIA BHARATRATNAS SCHOOL.,LEAD INDIA BHARATRATNAS SCHOOL, sy.no.77, 78,79.BANDLAGUDA V, KEESARA M, MEDCHAL D, HYDERABAD, TELANGANA STATE/- Ahmedguda/Keesara/Medchal**

2) The above said building was issued No Objection certificate vide reference cited (2) for Non Multi storeyed Building with **1 Ground, 3 Floors**, with a height of **12.00** Meters for **EDUCATIONAL B-1 Schools up to senior secondary level** Occupancy .

3) Now the Builder/Authorized person has requested to issue Renewal of No Objection Certificate for Occupancy to the Non Multi storeyed Building with **1 Ground, 3 Floors**, with a height of **12.00** Meters for **EDUCATIONAL B-1 Schools up to senior secondary level** Occupancy

4) Open Spaces:The builder provided the following open spaces all around the building.

Sl.No	Side	Open spaces as per Noc occupancy	Open spaces provided now
a 1	North	6.00	30.00
2	South	6.00	2.00
3	East	6.00	23.60
4	West	6.00	20.40
b	Sl. No	Gate Width As per Occupancy NOC	as per Noc occupancy provided now
1	1	Entry gate width	6.00
2	2	Entry Gate Head Clearance	5.00
3	3	Exit Gate Width	6.00



**GOVERNMENT OF TELANGANA**  
**FIRE, DISASTER RESPONSE, EMERGENCY & CIVIL DEFENCE DEPARTMENT**



4	Exit Gate Head Clearance	5.00	5.00
---	--------------------------	------	------

5) Travel Distance

Sl. No.	Item / Description	as per Noc occupancy	provided now
1	Farthest point ( Most Remote Point) With in a storey or a mezzanine floor to the door to an Exit.	28.00	28.00
2	The Dead end of the corridor length in exit access. ( 6 mtrs for Educational, Institutional and Assembly, 15mtrs for other Occupancies)	6.00	6.00

6) Stair Cases (As per Occupancy NOC) :

Sl.no.	Type of staircases	Total width	No of staircases	Floors from	Floors to
1	Internal staircases	2.00	1	Ground	Terrace
2	External staircases	1.20	1	Ground	Terrace

7) Means of Escape Floor Wise Details :

Sl.no	Floor type	Buil-up Area in Sq.Mtrs	Type of Occupancy	Occupant Load	Means of escape required as per Occupancy NOC	Means escape available now
1	Ground	445.50	EDUCATIONAL B-1 Schools up to senior secondary level	111.00	2.23	6.00
2	1st Floor	445.50	EDUCATIONAL B-1 Schools up to senior secondary level	111.00	2.23	3.20
3	2nd Floor	445.50	EDUCATIONAL B-1 Schools up to senior secondary level	111.00	2.23	3.20
4	3rd Floor	175.00	EDUCATIONAL B-1 Schools up to senior secondary level	44.00	0.88	3.20
<b>Total</b>		<b>1511.50</b>				

8) Fire Shaft as per Occupancy NOC:

9) Floor Wise details of Fire Fighting Installations:

Sl.no	Floor Details	Fire Extinguisher	Hose Reel	Automatic Sprinklers System	Manually Operated Electronic Fire Alarm System	Automatic detection and alarm system
1	Ground	3.00	1.00	0.00	0.00	0.00
2	1st Floor	3.00	1.00	0.00	0.00	0.00
3	2nd Floor	3.00	1.00	0.00	0.00	0.00
4	3rd Floor	1.00	1.00	0.00	0.00	0.00

10) Fire Fighting Installations As per Occupancy NOC :

Fire Fighting System.	Required As per Occupancy NOC	Provided
Fire Extinguishers	10	10
First Aid Hose Reel	4	4
Capacity of Terrace Tank over Respective Tower Terrace in Litres	10000	10000
Pump capacity in LPM at the Terrace Tank level with min Pressure of 3.5 Kg/CM <sup>2</sup>	450	450



**GOVERNMENT OF TELANGANA**  
**FIRE, DISASTER RESPONSE, EMERGENCY & CIVIL DEFENCE DEPARTMENT**



No. of Terrace Tanks over Respective Tower in ltrs	1	1
No. of Pumps at the Terrace Tank level with min pressure of 3.5 Kg/Cm <sup>2</sup>	1	1

11). The Non Multi storeyed Building Inspection Committee have reported that the Management has provided the Fire Safety Measures and there is no deficiencies.


**12. Remarks :**

As per recommendation of the inspection committee, the renewal of Noc for occupancy is approved.

13) In view of the above and as per recommendations of the Non Multi storeyed building inspection Committee, the Renewal of No Objection Certificate for occupancy is issued to Non Multi storeyed Building with **LEAD INDIA BHARATRATNAS SCHOOL., LEAD INDIA BHARATRATNAS SCHOOL, sy.no.77, 78,79.BANDLAGUDA V, KEESARA M, MEDCHAL D, HYDERABAD, TELANGANA STATE/-Ahmedguda/Keesara/Medchal** with a height of **12.00** Meters for **EDUCATIONAL B-1 Schools up to senior secondary level** Occupancy subject to the following conditions

Sl No	Builder and Management Body	Occupant	Management Body and fire and security personnel
1	-a) All the fire protection arrangements shall be maintained in good condition as seen during inspection. -b) Do's and Don'ts in case of fire shall be prominently displayed in entire building	All the escape/exit roots shall not be kept locked/blocked or encroached	All the occupants must know the correct method of operation of the fire fighting systems installed.
2	Any loss of life or property due to non-functioning of fire safety measures and other installations shall be the responsibility of the management.	All occupants shall be trained to operate the fire safety equipment during emergency.	Mock drills should be conducted once in 3 months for initial two years. Thereafter, once in every 6 months.
3	Addition / alteration, if any in the building may be verified by building authority.	Mock drills should be conducted once in 3 months for initial two years. Thereafter, once in every 6 months.	All security personnel shall be trained to operate the fire safety equipment during emergency and guiding the occupants in safe evacuation. Call the fire Brigade by dialing 101.
4	This No objection Certificate for occupancy is valid for Five Years from the date of issue of this letter.	Raise the alarm if the fire cannot be controlled, evacuate the area completely at once from the nearest safe exit.	Attack the fire using available fire equipment only if you feel capable of controlling it. If not, take all steps to isolate the area by closing doors and windows.

This Renewal of No Objection Certificate for Occupancy is valid for Five Years from the date of issue of this letter. It is the responsibility of the builder to apply for renewal NOC, duly remitting the user charges as per G.O. Ms. No. 71, Home (Prison - A) Department, dated 01-04-2010, two months before expiry of this No Objection Certificate.

  
 Signed By : Mr. V. Srinivas  
 Designation : District Fire Officer , Malkajgiri  
 Date : 15-04-2026  
 Medchal District.




GOVERNMENT OF TELANGANA  
FIRE, DISASTER RESPONSE, EMERGENCY & CIVIL DEFENCE DEPARTMENT



"THIS IS COMPUTER GENERATED DOCUMENT AND DO NOT REQUIRE ANY STAMP OR SIGNATURE"

Copies to:

- i) The Management
- ii) Non Multi storeyed Building Inspection Committee
- iii) Copy submitted to Regional Fire officer
- iv) Copy submitted to DG fire services

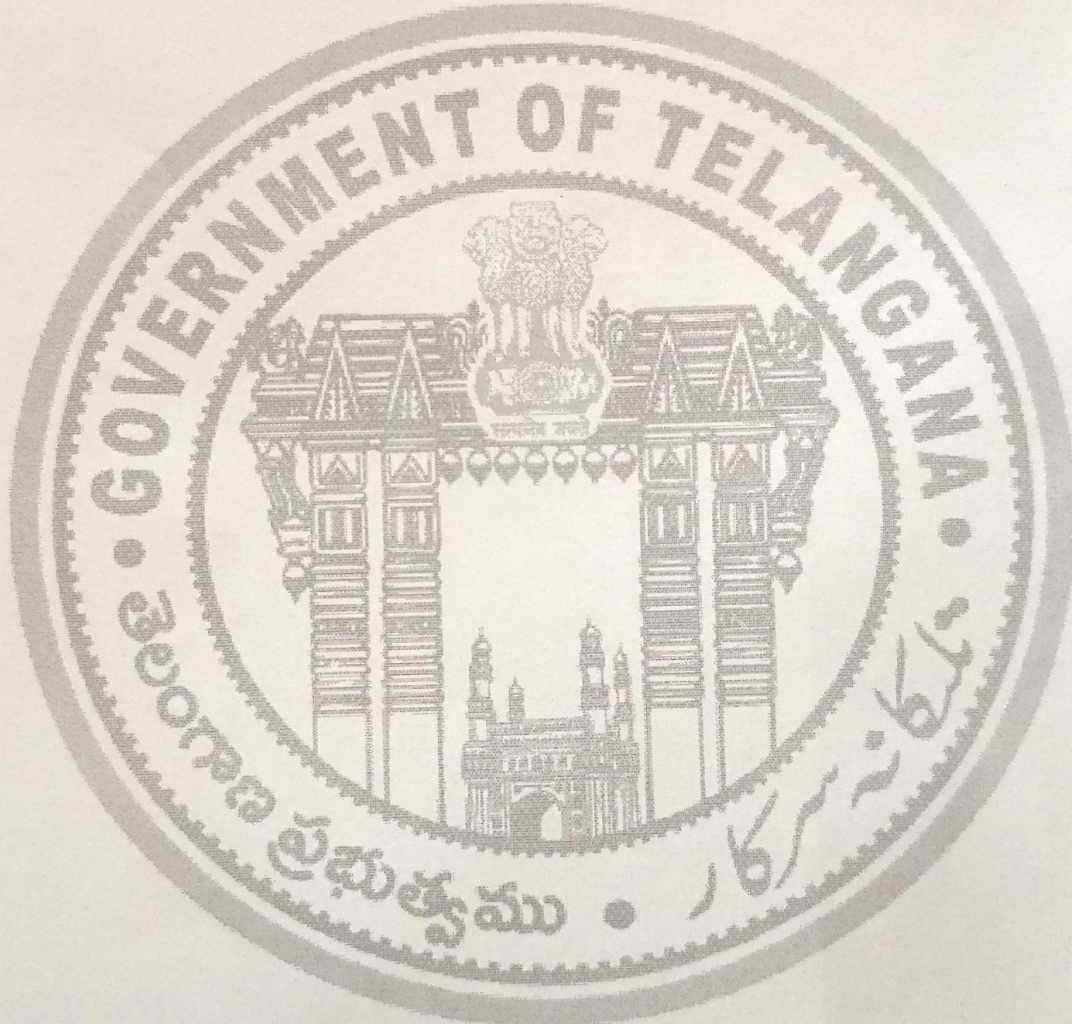

FIRE SAFETY CERTIFICATE

APPENDIX - XII

No.

Dated: 04.06.2024

Certified that the LEAD INDIA BHARAT RATNAS SCHOOL at Survey. No. 77,78 & 79 AHMEDGUDA(V), KEESARA (M), MEDCHAL – MALKAJGIRI District, Telangana comprised of '1' (ONE) basement(s) and '3' THREE (upper floors) occupied by LEAD INDIA BHARAT RATNAS SCHOOL have complied with the fire prevention and fire safety requirements in accordance with rule of State/ UT Fire Service Rules, and verified by the officers concerned of Fire Service on 4<sup>th</sup> June 2024 in the presence of Tanikonda Hemanth, Secretary at Survey No. 77,78 & 79, Ahmedguda (V), Keesara Mandal, Medchal – Malkajgiri District the and that the building/ premises is fit for occupancy upto classes XII ( X/ XII) With effect from 04-06-2024 for a period of 2 years in accordance with rule and subject to compliance of specific conditions as appended:-

1. Fire buckets to be installed in 3<sup>rd</sup> Floor.

Issued on 04-06-2024 at Fire Station, Cherlapally by

Signature with Seal: ..... STATION FIRE OFFICER  
FIRE STATION CHERLAPALLY

Name : V. SHEKHAR REDDY

Designation : STATION FIRE OFFICER

Name & Address of Department/ Office: .....

To

The Correspondent  
Lead India Bharat Ratnas School  
Survey No. 77,78 & 79,  
Ahmedguda(v), Keesara Mandal  
Medchal- Malkajgiri District,  
Telangana



*Caromya*

ENDORSEMENT

The No Objection Certificate issued by Fire Service stand cancelled an annulled due to .....  
(reasons to be recorded).

(Name and designation of the authorized signatory)

\* The filled up certificate should be either in Hindi or English. If it is issued in vernacular language, translated notarized version in English be uploaded along with the original vernacular certificate as a single pdf.